


Norris Electric Cooperative
Single Phase, 120/240v, 400 AMP Pole Top Disconnect Meter Installations

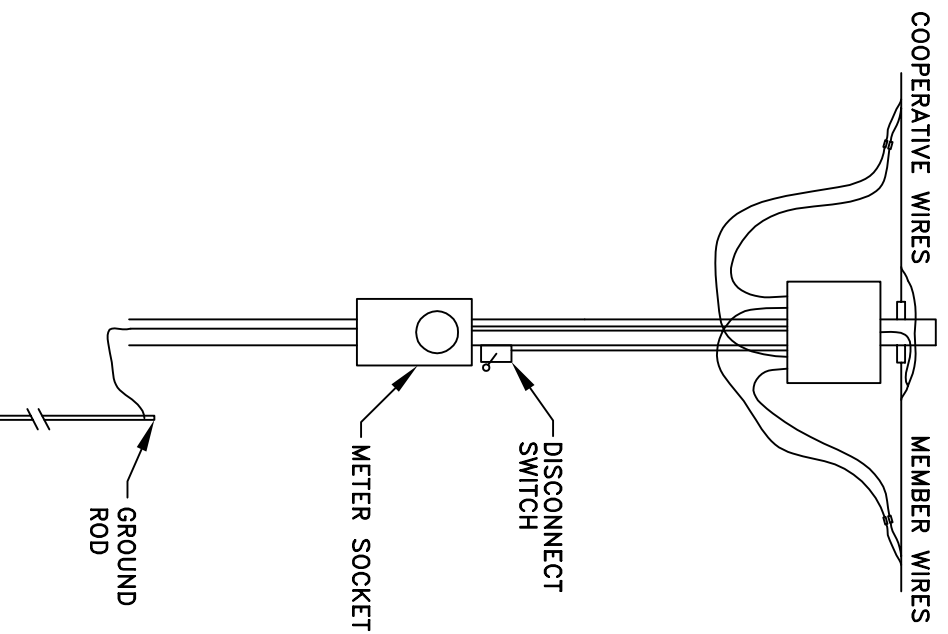

METER BASE DETAILS

Ronk 400 AMP pole top (O/H) disconnect – 9422
Member to provide all disconnects, CT's and wiring to meter socket
Norris Electric Cooperative will provide the meter socket only.
Meter socket to be mounted 66" from ground to center of socket.

When purchasing Ronk 400 AMP box, specify parallel lug
connection on line and load sides.

1" conduit, weatherhead and (4) # 12 THHN conductors must be
installed on pole.